


1 EXISTING CONDITIONS
 1 SCALE: NONE

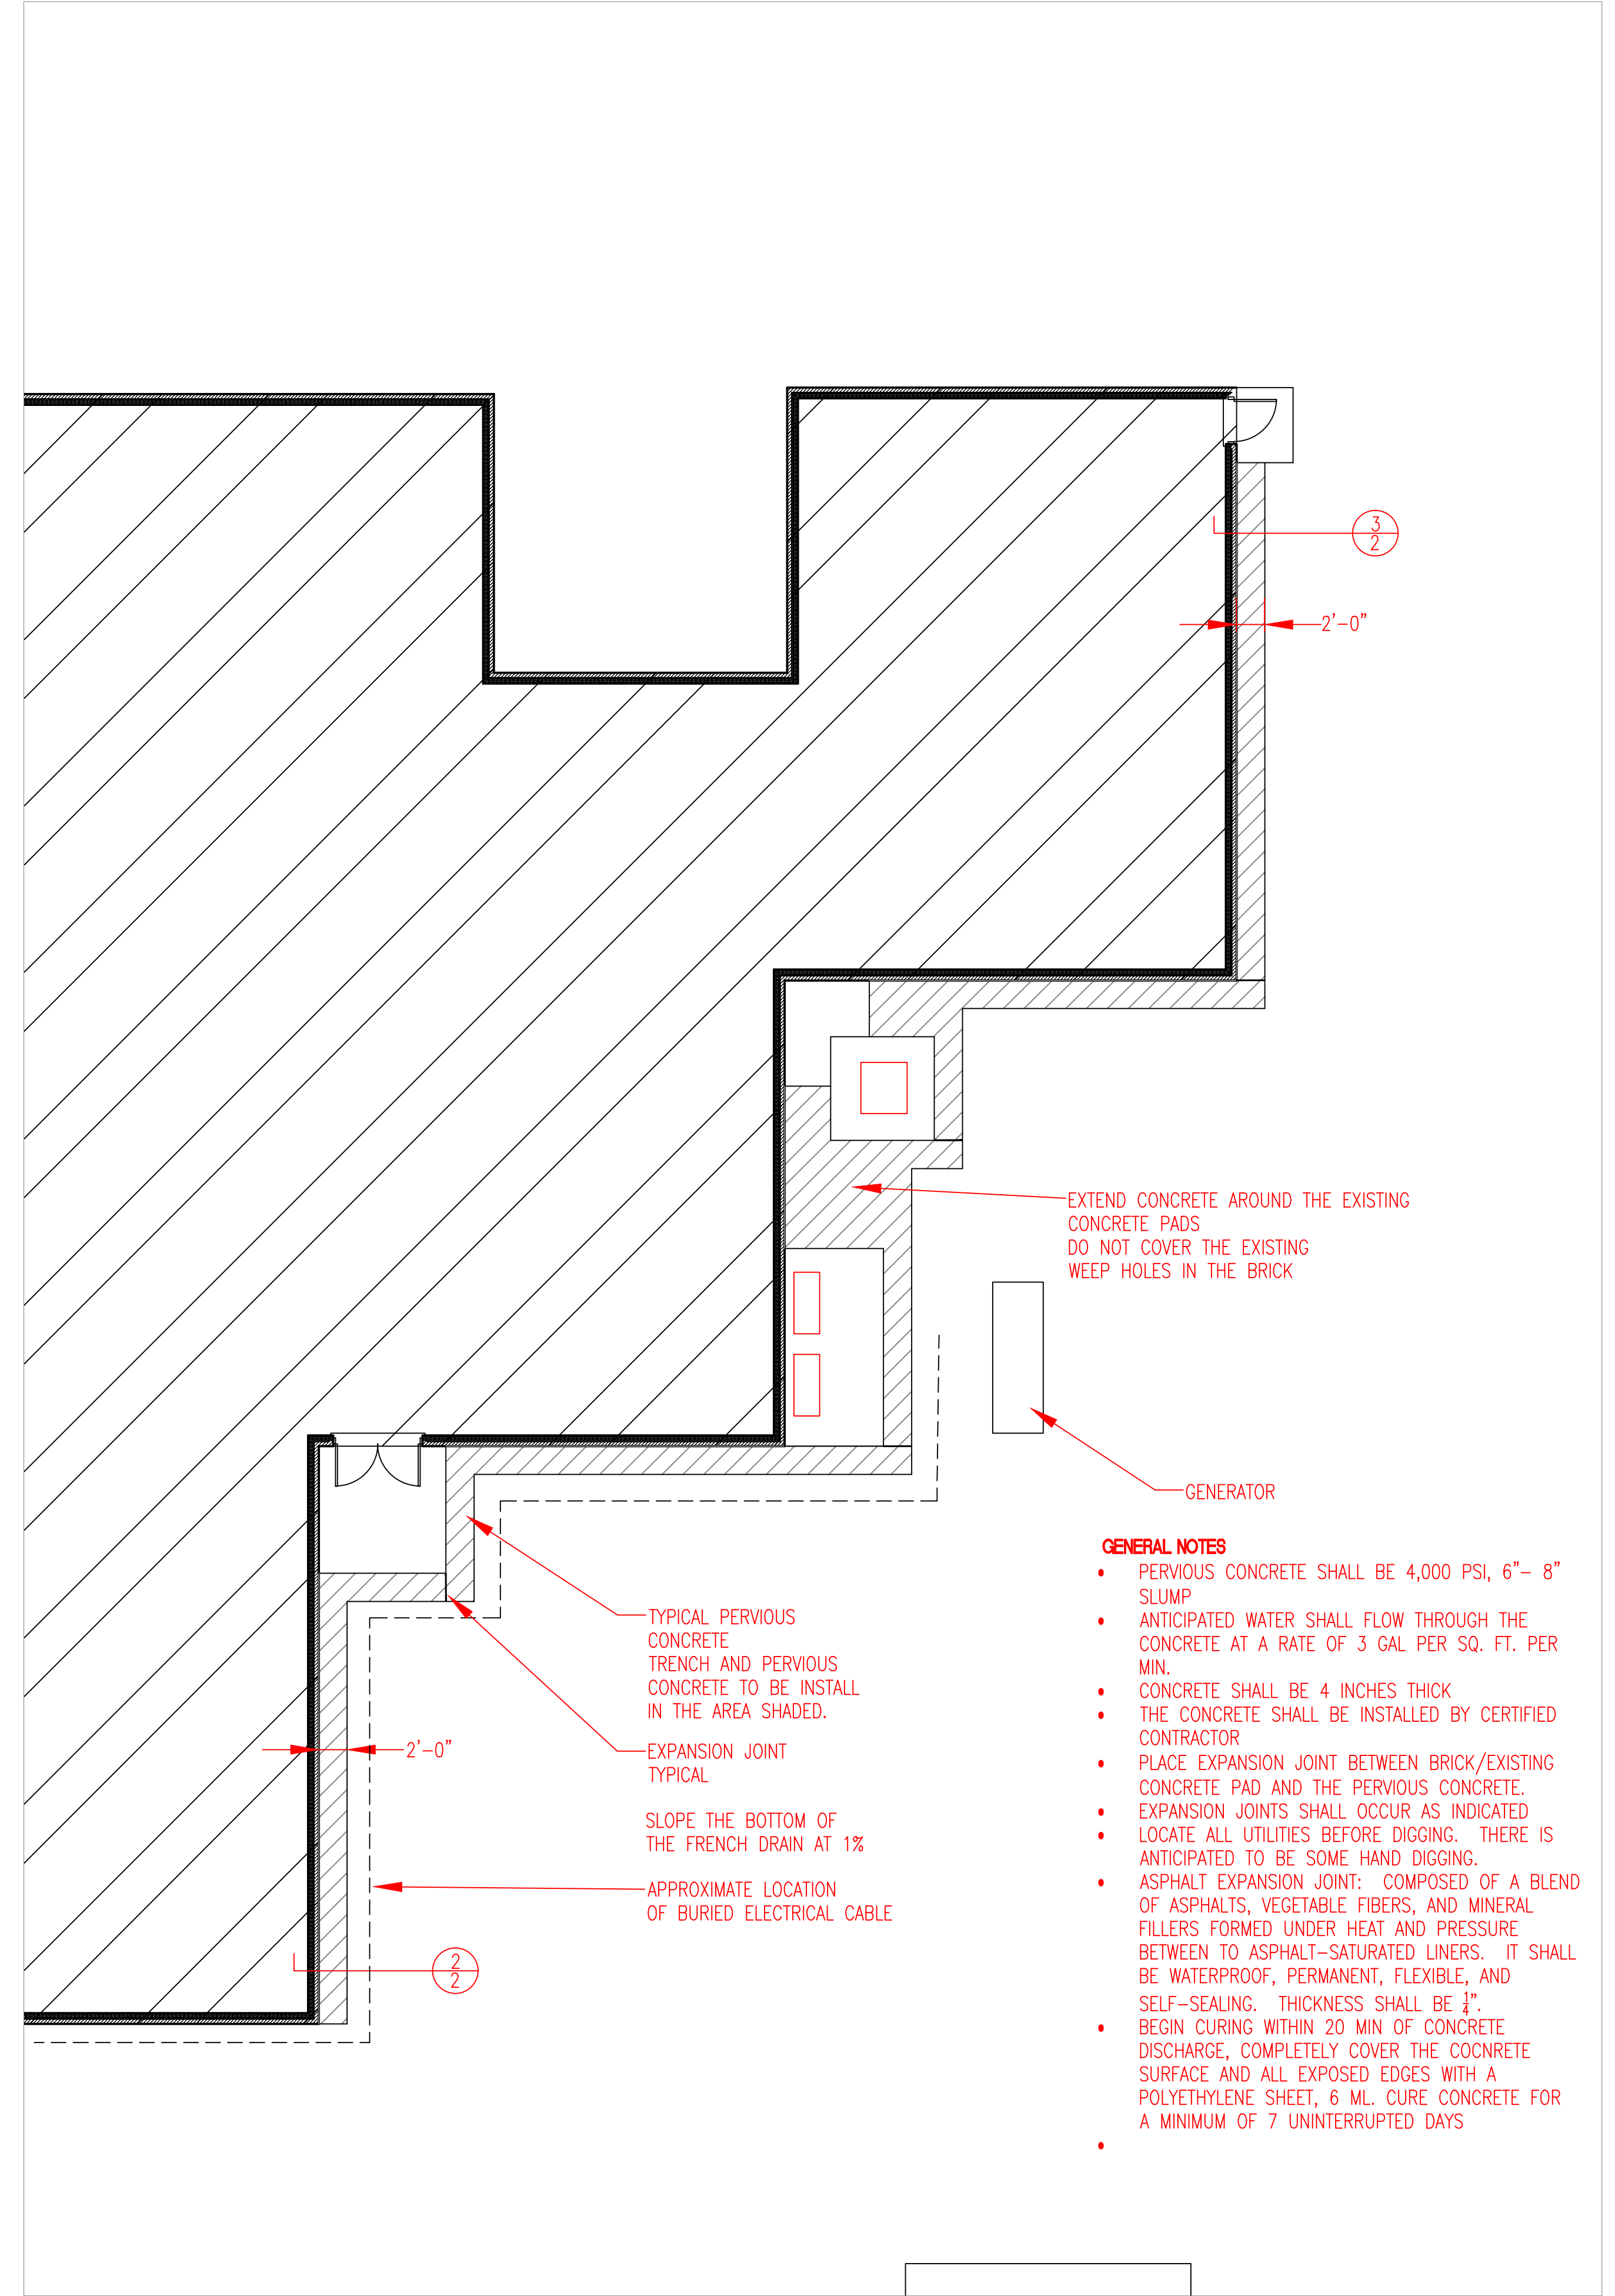

2 PROPOSED LOCATION OF PERVIOUS CONCRETE
 1 SCALE: NONE

- GENERAL NOTES**
- PERVIOUS CONCRETE SHALL BE 4,000 PSI, 6" - 8" SLUMP
 - ANTICIPATED WATER SHALL FLOW THROUGH THE CONCRETE AT A RATE OF 3 GAL PER SQ. FT. PER MIN.
 - CONCRETE SHALL BE 4 INCHES THICK
 - THE CONCRETE SHALL BE INSTALLED BY CERTIFIED CONTRACTOR
 - PLACE EXPANSION JOINT BETWEEN BRICK/EXISTING CONCRETE PAD AND THE PERVIOUS CONCRETE.
 - EXPANSION JOINTS SHALL OCCUR AS INDICATED
 - LOCATE ALL UTILITIES BEFORE DIGGING. THERE IS ANTICIPATED TO BE SOME HAND DIGGING.
 - ASPHALT EXPANSION JOINT: COMPOSED OF A BLEND OF ASPHALTS, VEGETABLE FIBERS, AND MINERAL FILLERS FORMED UNDER HEAT AND PRESSURE BETWEEN TO ASPHALT-SATURATED LINERS. IT SHALL BE WATERPROOF, PERMANENT, FLEXIBLE, AND SELF-SEALING. THICKNESS SHALL BE 1/2".
 - BEGIN CURING WITHIN 20 MIN OF CONCRETE DISCHARGE, COMPLETELY COVER THE CONCRETE SURFACE AND ALL EXPOSED EDGES WITH A POLYETHYLENE SHEET, 6 ML. CURE CONCRETE FOR A MINIMUM OF 7 UNINTERRUPTED DAYS

Project No.		WTVI FRENCH DRAIN	
Drawn By:	DOUGLAS BUCHANAN		
Checked By:			
Approved By:			
Scale:			
Date:	9-12-12	SHEET NO. 1	
CS:	04/10/96 08:38	FILE:	